


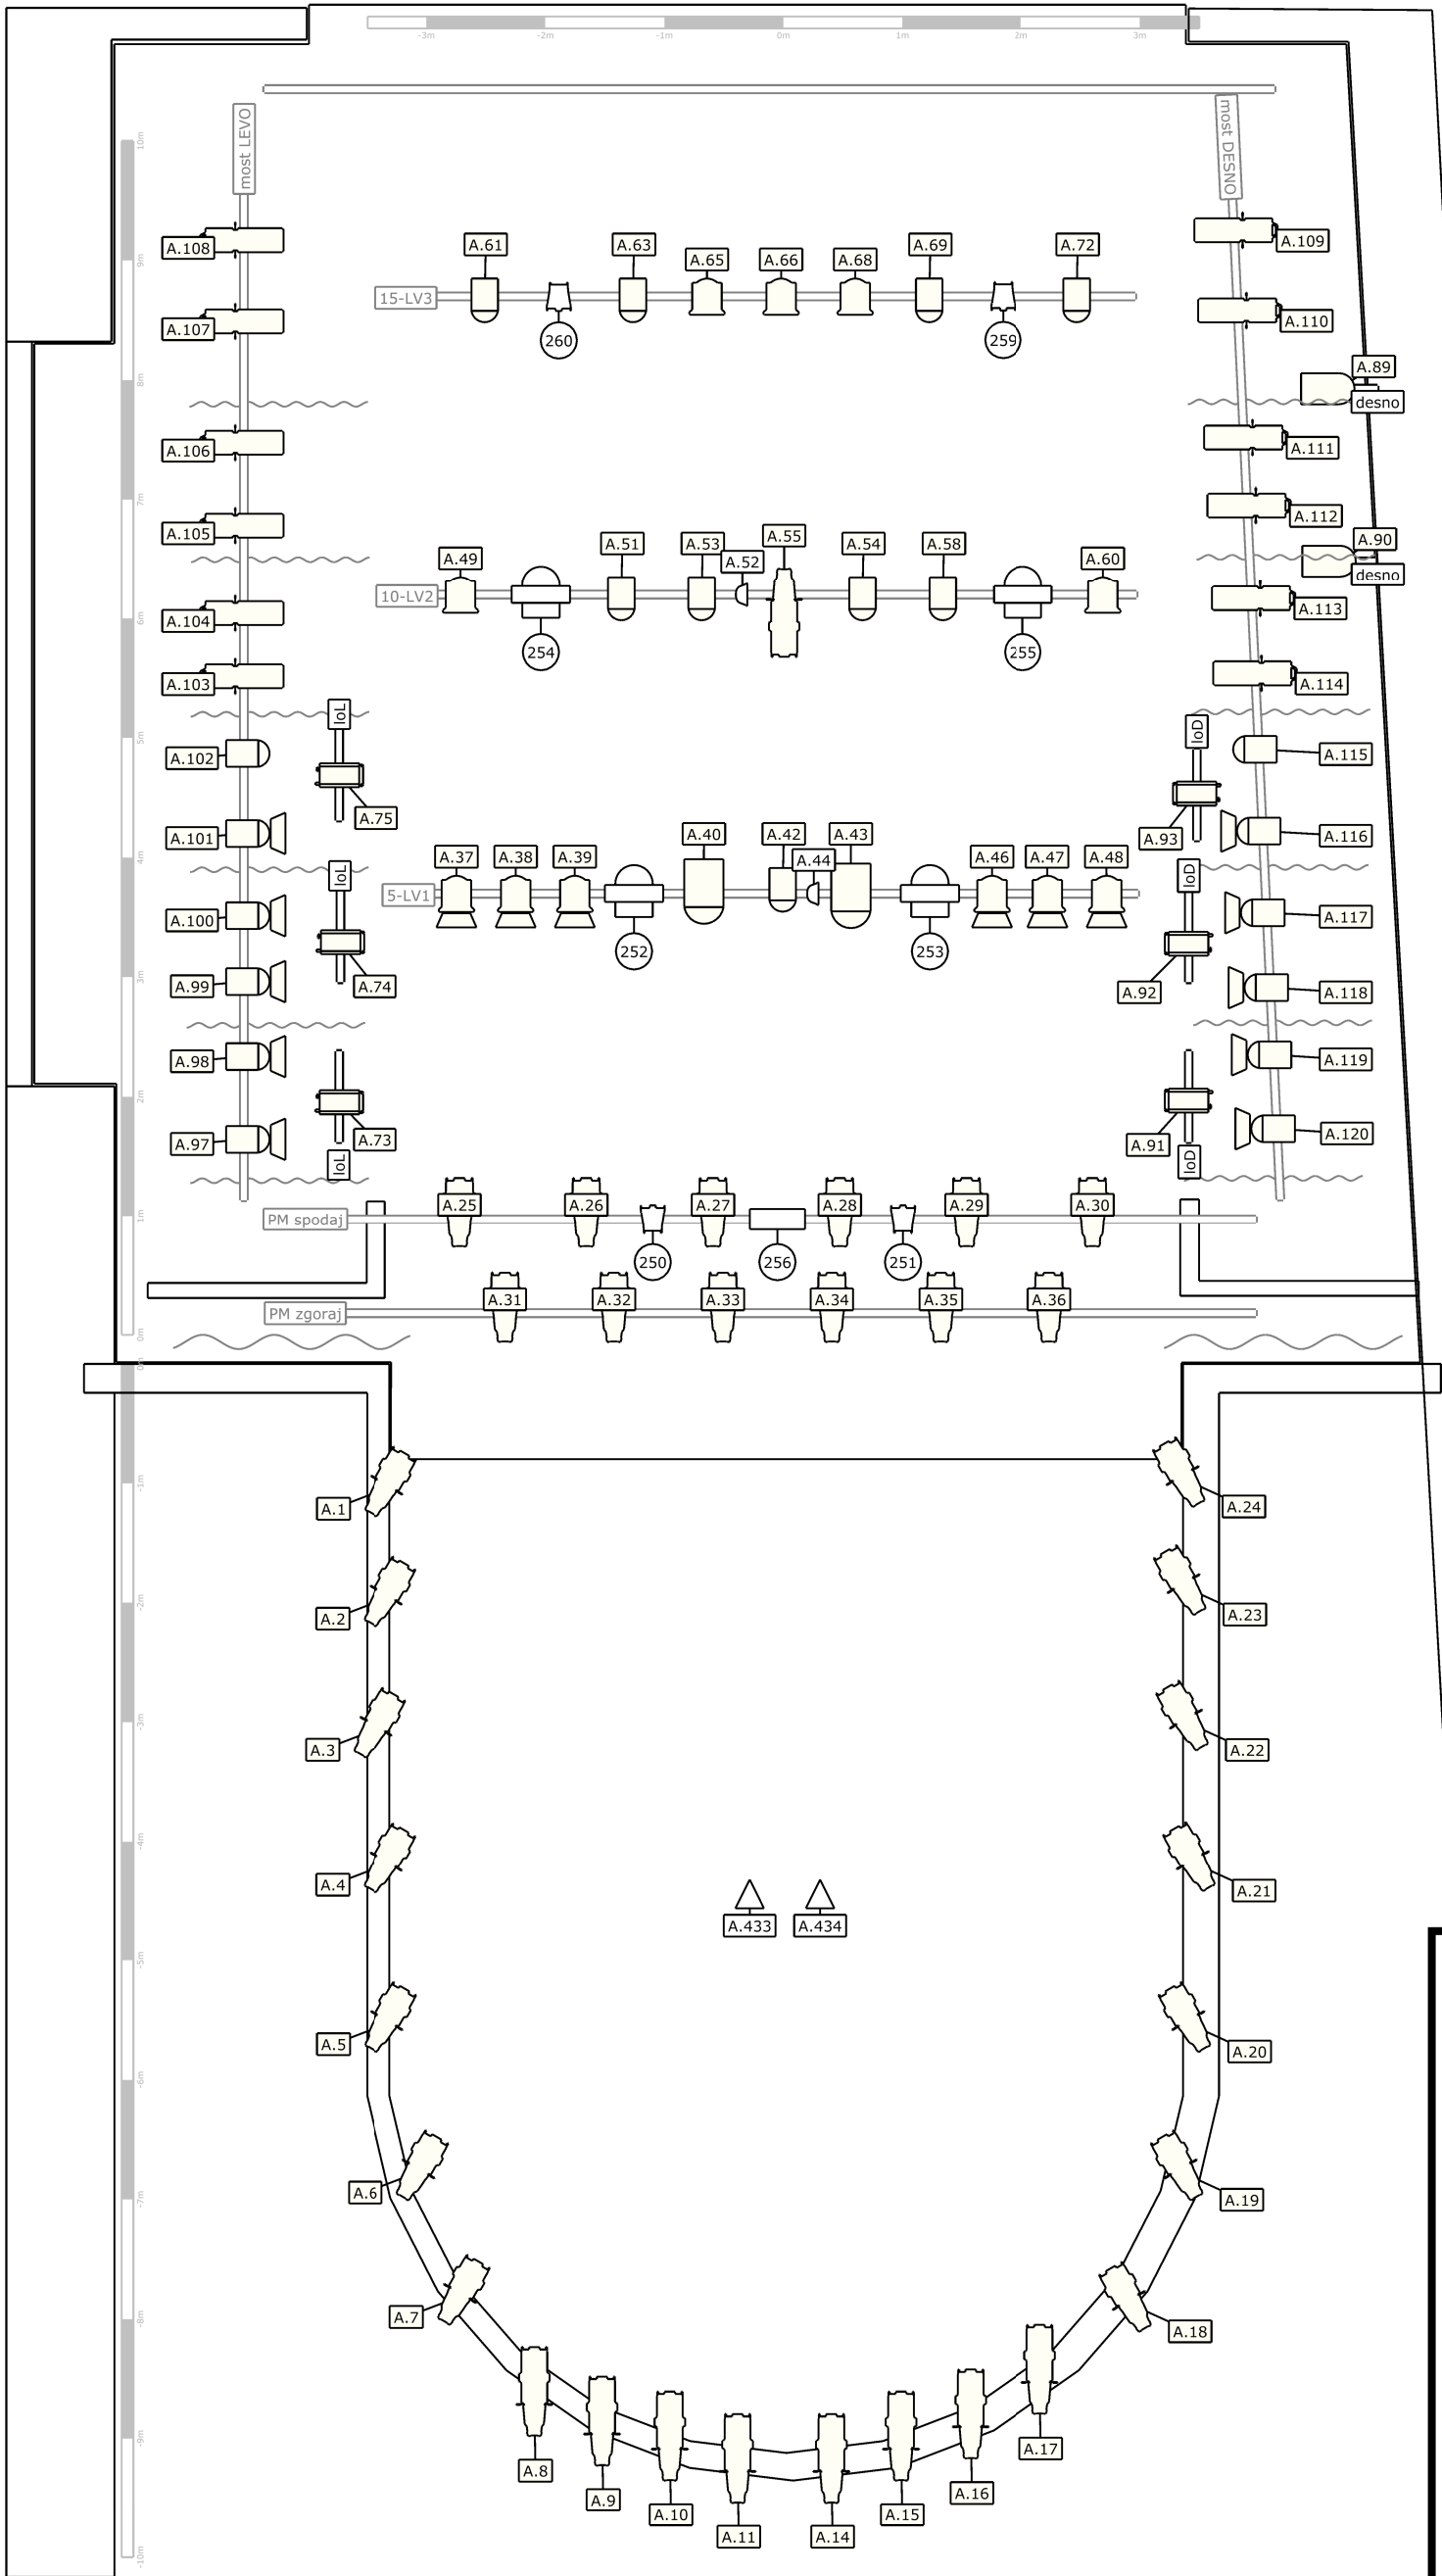

Symbol key	
	ETC Zoom 25°-50° (26)
	PC 1kW (21)
	RJ 16°-35° (12)
	Fr 2kW (11)
	ETC Zoom 15°-30° (9)
	PC 1kW (6)
	CAMEO LED CLP 18 RGBW (4)
	ETC LED PAR (Deep Blue) (4)
	PAR64 (2)
	dvorana (2)
	Flood 1 kW (2)
	PC 2kW (2)
	UV Flood 36 (1)

Project	Content LIGHTING PLOT - osnova	Lighting technician:	Note:
Project location Mestno gledališče Ptuj	Lighting designer	Technical consultant:	
Project date	Set designer	Producer:	
Client MESTNO GLEDALIŠČE PTUJ Slovenski trg 13, 2250 Ptuj tel. +386 2 749 32 50 info@mgp.si, www.mgp.si	Director		
	Drawing version februar 2025- (do)		

OSNOVNA POSTAVITEV-Fixture report (februar 2025)

Mestno gledališče Ptuj

Slovenski trg 13, 2250 Ptuj, T: +386 2 749 32 50, E: info@mgp.si, W: www.mgp.si

PATCH - Fixtures

Patch	Channel	Unit	Location	Filters	Purpose	Focus
	256	UV	PM spodaj			
	251	LEDdeep	PM spodaj			
	252	LED 18 RGBW	5-LV1			
	259	LEDdeep	15-LV3			
	254	LED 18 RGBW	10-LV2			
	260	LEDdeep	15-LV3			
	255	LED 18 RGBW	10-LV2			
	250	LEDdeep	PM spodaj			
	253	LED 18 RGBW	5-LV1			
A.1		ETC25/50	dvorana			
A.2		ETC25/50	dvorana			
A.3		ETC25/50	dvorana			
A.4		ETC25/50	dvorana			
A.5		ETC25/50	dvorana			
A.6		ETC25/50	dvorana			
A.7		ETC25/50	dvorana			
A.8		ETC15/30	dvorana			
A.9		ETC15/30	dvorana			
A.10		ETC15/30	dvorana			
A.11		ETC15/30	dvorana			
A.14		ETC15/30	dvorana			
A.15		ETC15/30	dvorana			
A.16		ETC15/30	dvorana			
A.17		ETC15/30	dvorana			
A.18		ETC25/50	dvorana			
A.19		ETC25/50	dvorana			
A.20		ETC25/50	dvorana			
A.21		ETC25/50	dvorana			
A.22		ETC25/50	dvorana			
A.23		ETC25/50	dvorana			
A.24		ETC25/50	dvorana			
A.25		ETC25/50	PM spodaj			
A.26		ETC25/50	PM spodaj			
A.27		ETC25/50	PM spodaj			
A.28		ETC25/50	PM spodaj			
A.29		ETC25/50	PM spodaj			
A.30		ETC25/50	PM spodaj			
A.31		ETC25/50	PM zgoraj			

A.32	ETC25/50	PM zgoraj	
A.33	ETC25/50	PM zgoraj	
A.34	ETC25/50	PM zgoraj	
A.35	ETC25/50	PM zgoraj	
A.36	ETC25/50	PM zgoraj	
A.37	Fr2kW	5-LV1	
A.38	Fr2kW	5-LV1	
A.39	Fr2kW	5-LV1	
A.40	PC 2kW	5-LV1	
A.42	PC 1kW	5-LV1	
A.43	PC 2kW	5-LV1	
A.44	delovna	5-LV1	delovna
A.46	Fr2kW	5-LV1	
A.47	Fr2kW	5-LV1	
A.48	Fr2kW	5-LV1	
A.49	Fr2kW	10-LV2	
A.51	PC 1kW	10-LV2	
A.52	delovna	10-LV2	delovna
A.53	PC 1kW	10-LV2	
A.54	PC 1kW	10-LV2	
A.55	ETC15/30	10-LV2	
A.58	PC 1kW	10-LV2	
A.60	Fr2kW	10-LV2	
A.61	PC 1kW	15-LV3	
A.63	PC 1kW	15-LV3	
A.65	Fr2kW	15-LV3	
A.66	Fr2kW	15-LV3	
A.68	Fr2kW	15-LV3	
A.69	PC 1kW	15-LV3	
A.72	PC 1kW	15-LV3	
A.73	PC 1kW	loL	
A.74	PC 1kW	loL	
A.75	PC 1kW	loL	
A.89	PAR64	desno	
A.90	PAR64	desno	
A.91	PC 1kW	loD	
A.92	PC 1kW	loD	
A.93	PC 1kW	loD	
A.97	PC 1kW	most LEVO	
A.98	PC 1kW	most LEVO	
A.99	PC 1kW	most LEVO	
A.100	PC 1kW	most LEVO	
A.101	PC 1kW	most LEVO	
A.102	PC 1kW	most LEVO	
A.103	RJ	most LEVO	
A.104	RJ	most LEVO	
A.105	RJ	most LEVO	
A.106	RJ	most LEVO	
A.107	RJ	most LEVO	
A.108	RJ	most LEVO	
A.109	RJ	most DESNO	
A.110	RJ	most DESNO	

A.111	RJ	most DESNO	
A.112	RJ	most DESNO	
A.113	RJ	most DESNO	
A.114	RJ	most DESNO	
A.115	PC 1kW	most DESNO	
A.116	PC 1kW	most DESNO	
A.117	PC 1kW	most DESNO	
A.118	PC 1kW	most DESNO	
A.119	PC 1kW	most DESNO	
A.120	PC 1kW	most DESNO	
A.433	house lights	dvorana	prihod publike
A.434	house lights	dvorana	prihod publike

LOCATION - Fixtures

Location	Patch	Channel	Unit	Filters	Focus	Purpose
desno	A.89		PAR64			
desno	A.90		PAR64			
dvorana	A.1		ETC25/50			
dvorana	A.2		ETC25/50			
dvorana	A.3		ETC25/50			
dvorana	A.4		ETC25/50			
dvorana	A.5		ETC25/50			
dvorana	A.6		ETC25/50			
dvorana	A.7		ETC25/50			
dvorana	A.8		ETC15/30			
dvorana	A.9		ETC15/30			
dvorana	A.10		ETC15/30			
dvorana	A.11		ETC15/30			
dvorana	A.14		ETC15/30			
dvorana	A.15		ETC15/30			
dvorana	A.16		ETC15/30			
dvorana	A.17		ETC15/30			
dvorana	A.18		ETC25/50			
dvorana	A.19		ETC25/50			
dvorana	A.20		ETC25/50			
dvorana	A.21		ETC25/50			
dvorana	A.22		ETC25/50			
dvorana	A.23		ETC25/50			
dvorana	A.24		ETC25/50			
dvorana	A.433		house lights			prihod publike
dvorana	A.434		house lights			prihod publike
loD	A.91		PC 1kW			
loD	A.92		PC 1kW			
loD	A.93		PC 1kW			
loL	A.73		PC 1kW			
loL	A.74		PC 1kW			
loL	A.75		PC 1kW			
most DESNO	A.109		RJ			
most DESNO	A.110		RJ			
most DESNO	A.111		RJ			
most DESNO	A.112		RJ			

most DESNO	A.113	RJ	
most DESNO	A.114	RJ	
most DESNO	A.115	PC 1kW	
most DESNO	A.116	PC 1kW	
most DESNO	A.117	PC 1kW	
most DESNO	A.118	PC 1kW	
most DESNO	A.119	PC 1kW	
most DESNO	A.120	PC 1kW	
most LEVO	A.97	PC 1kW	
most LEVO	A.98	PC 1kW	
most LEVO	A.99	PC 1kW	
most LEVO	A.100	PC 1kW	
most LEVO	A.101	PC 1kW	
most LEVO	A.102	PC 1kW	
most LEVO	A.103	RJ	
most LEVO	A.104	RJ	
most LEVO	A.105	RJ	
most LEVO	A.106	RJ	
most LEVO	A.107	RJ	
most LEVO	A.108	RJ	
PM spodaj	256	UV	
PM spodaj	250	LEDdeep	
PM spodaj	251	LEDdeep	
PM spodaj	A.25	ETC25/50	
PM spodaj	A.26	ETC25/50	
PM spodaj	A.27	ETC25/50	
PM spodaj	A.28	ETC25/50	
PM spodaj	A.29	ETC25/50	
PM spodaj	A.30	ETC25/50	
PM zgoraj	A.31	ETC25/50	
PM zgoraj	A.32	ETC25/50	
PM zgoraj	A.33	ETC25/50	
PM zgoraj	A.34	ETC25/50	
PM zgoraj	A.35	ETC25/50	
PM zgoraj	A.36	ETC25/50	
5-LV1	253	LED 18 RGBW	
5-LV1	252	LED 18 RGBW	
5-LV1	A.37	Fr2kW	
5-LV1	A.38	Fr2kW	
5-LV1	A.39	Fr2kW	
5-LV1	A.40	PC 2kW	
5-LV1	A.42	PC 1kW	
5-LV1	A.43	PC 2kW	
5-LV1	A.44	delovna	delovna
5-LV1	A.46	Fr2kW	
5-LV1	A.47	Fr2kW	
5-LV1	A.48	Fr2kW	
10-LV2	255	LED 18 RGBW	
10-LV2	254	LED 18 RGBW	
10-LV2	A.49	Fr2kW	
10-LV2	A.51	PC 1kW	

10-LV2	A.52		delovna	delovna
10-LV2	A.53		PC 1kW	
10-LV2	A.54		PC 1kW	
10-LV2	A.55		ETC15/30	
10-LV2	A.58		PC 1kW	
10-LV2	A.60		Fr2kW	
15-LV3		259	LEDdeep	
15-LV3		260	LEDdeep	
15-LV3	A.61		PC 1kW	
15-LV3	A.63		PC 1kW	
15-LV3	A.65		Fr2kW	
15-LV3	A.66		Fr2kW	
15-LV3	A.68		Fr2kW	
15-LV3	A.69		PC 1kW	
15-LV3	A.72		PC 1kW	